

# Process Flat pH Sensor with Modbus output MBRTU-PHFLAT

- [USER GUIDE FOR PROCESS FLAT PH SENSOR WITH MODBUS OUTPUT MBRTU-PHFLAT](#)

# USER GUIDE FOR PROCESS FLAT PH SENSOR WITH MODBUS OUTPUT MBRTU-PHFLAT

JUL-2021

*This document is applied for the following products*

## 1. Introduction

MBRTU-PHFLAT is a general purpose in-line (continuous measurement) pH sensor offering affordable, flat sensor application coverage for many water applications such as drinking water, industrial water, aquaculture, tank installations or related applications. The flat surface sensor is often referred to as "self-cleaning" when installed in a process stream since the water flow has a tendency to "shear off" biofouling and other debris from the sensor surface. Output is Modbus RTU for easily integrating with any PLC, controller, SCADA, BMS or IoT gateway.

- Robust pH electrode for continuous measurement;
- Self-cleaning flat electrode;
- Standard ModbusRTU output;
- Plug & Play.

**Typical Applications:** Drinking water, Waste water, Industrial water, Aquaculture,...

PROCESS PH FLAT SENSOR  
WITH TEMPERATURE COMPENSATION  
MBRTU-PHFLAT




MBRTU-PHFLAT-H1.PNG

## 2. Specification

**pH SENSOR SPECIFICATION**

Sensing Technology	Glass, combine electrode with Pt100 temperature sensor
Measuring range	pH 0 .. 14
Resolution	pH 0.1
Accuracy	+/- 0.1
Working temperature	0 .. 100 oC (compensated)
Working pressure	0 .. 100 psig
Process connection	3/4" NPT both ends
Wetted parts	PVC
Sensor Cable	6m with BNC connector
Rating	IP68
Sensor Dimension	D27 x 172 (mm)
Sensor net weight	< 200 grams
<b>pH TRANSMITTER SPECIFICATION</b>	
Inputs	pH and Pt100
Output	RS485, ModbusRTU protocol, max 19200 baud
Power supply	9..36VDC, avg. < 200mA
Mounting	DIN Rail
Working temperature	-40 .. 85 oC
Working humidity	0 .. 95% RH, non-condensing
Housing	Engineered Plastic
Ingress Protection	IP20
Dimension	93 x 40 (mm)
Net weight	<200 grams

### 3. Dimensions

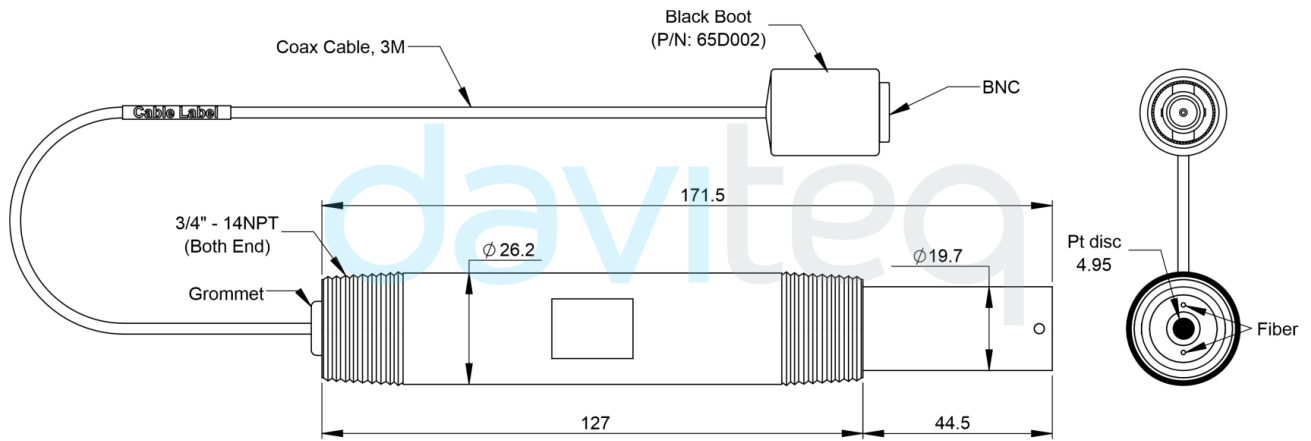

## 4. Wiring

Please wiring as shown below:





# 5. Memmap registers

**Function Code: 3 (Read); 16 (Write)**

Modbus Register (Dec)	Modbus Register (Hex)	Function Code (Read)	Function Code (Write)	# of Registers	Description	Range	Default	Format	Properties	Comment
2	2	3		4	Firmware version			string	Read	
6	6	3		2	Hardware version			string	Read	
9	9	3		2	pH (prm 1)			float	Read	
11	B	3		1	error & sensor type			uint16	Read	Hi-Byte is error code, Lo-Byte is sensor type
12	C	3		2	Temperature (prm 2)			float	Read	
14	E	3		2	pH_Adc			float	Read	
16	10	3		2	pH_mV			float	Read	
18	12	3		2	tempRes			float	Read	
256	100	3	16	1	Modbus address	1-247	1	uint16	Read/V	Modbus address of device
257	101	3	16	1	Modbus baudrate	0-1	0	uint16	Read/V	Baudrate: 0: 9600, 1: 19200
258	102	3	16	1	Modbus parity	0-2	0	uint16	Read/V	Parity: 0: none, 1: odd, 2: even
280	118	3	16	2	a1		1	float	Read/V	Scale value of parameter_1 = (a1 * Raw sensor value of parameter_1) + b1
282	11A	3	16	2	b1		0	float	Read/V	Scale value of parameter_1 = (a1 * Raw sensor value of parameter_1) + b1
284	11C	3	16	2	a2		1	float	Read/V	Scale value of parameter_2 = (a2 * Raw sensor value of parameter_2) + b2

286	11E	3	16	2	b2		0	float	Read/V	Scale value of parameter_2 = (a2 * Raw sensor value of parameter_2) + b2
298	12A	3	16	1	calcTime (sec)		1	uint16	Read/V	Set default <b>1 sec</b> for MBRTU
299	12B	3	16	1	calibEnb		0	uint16	Read/V	Before calibration, must turn on <b>caribE = 1</b> . After calibration, set <b>calibEnb = 0</b>
300	12C	3	16	2	pHFeedback			float	Read/V	<p><b>Step 1:</b> Calibrate with standard solution <b>pH = 7.01</b>, wait for about <b>3 minutes</b> for the reading to stabilize, write <b>7</b> down to pHFeedback</p> <p><b>Step 2:</b> Calibrate with standard solution <b>pH = 4.01</b> or <b>10.01</b>, wait about <b>3 minutes</b> for reading to stabilize, write down <b>pHFeedback</b> pH value of solution</p>
302	12E	3	16	2	pHFactor			float	Read	
304	130	3	16	2	pH7_adc			float	Read	
306	132	3	16	2	pH7_mV			float	Read	
308	134	3	16	2	wire resistance		1.74	float	Read/V	Compensate for conductor resistance
310	136	3	16	2	Manual_Tem			float	Read/V	
312	138	3	16	1	Manual_Tem		0	uint16	Read/V	When there is no temperature sensor, turn on <b>Manual_Temp = 1</b> , then <b>Temperature (prm 2) = Manual_Temp</b>

**Note 1:** Before calibrating the sensor, set **calibEnb = 1**, after calibrating the sensor, set **calibEnb = 0**

**Note 2:**

- **Step 1:** Calibrate with standard solution **pH = 7.01**, wait about **3 minutes** for the reading from the sensor to stabilize, write **7** down to pHFeedback
- **Step 2:** Calibrate with standard solution **pH = 4.01** or **10.01**, wait about **3 minutes** for the reading to stabilize, write down the pHFeedback pH value of the solution.

**Note 3:** When there is no temperature sensor, set **Manual\_Temp\_Enb = 1**, then **Temperature (prm 2) = Manual\_Temp\_Input**

## 6. Required Equipment and Solutions

- pH meter (a temperature compensator is recommended for increased pH measurement accuracy)
- pH Buffer **4.01** or **10.01**
- pH Buffer **7.01**
- Reference filling solution (see list for particular pH electrode type)
- Wash bottle filled with distilled or de-ionized water
- Laboratory magnetic stirrer and magnetic stir bars
- Lab wipes
- Clean beakers

## 7. Preparation of the Electrode for Initial Use

1. Remove the protective bottle or cover from the electrode and thoroughly rinse the electrode with distilled water. Wipe carefully with a clean lab wipe.
2. During shipment, air bubbles may have migrated into the electrode sensing bulb. Hold the electrode up to the light and inspect the sensing bulb for air bubbles. If air is seen, carefully shake the electrode downward (like a thermometer) to dispel the air bubble from the sensing bulb at the tip of the electrode.
3. For refillable models, uncover the filling port to expose the electrode reference chamber fill hole (for sealed, gel filled electrodes, disregard this operation).
4. Fill the reference chamber with the appropriate pH reference filling solution. Electrodes that have been filled with the incorrect filling solution are not covered under warranty.

## 8. Reference Filling Solution Selection

- For pH combination electrodes with Calomel and Double Junction Ag/AgCl reference half cells, use 4 M KCl reference filling solution.
- For pH combination electrodes with Single Junction Ag/AgCl reference half cells, use 4 M KCl saturated with AgCl reference filling solution.

## 9. Calibration

Before use, the instrument should be calibrated with standard solutions;

The first is calibration with standard solution **pH = 7.01**. Buy standard solutions here:

- <https://www.hannavietnam.com/detail-product/chuan-ph-701-500ml-19>
- <https://www.hannainstruments.co.uk/ph-7-01-buffer-solution.html>

The next step is to calibrate with standard solution **pH = 4.01** or **10.01**. Buy standard solutions here:

- <https://www.hannavietnam.com/detail-product/chuan-ph-1001-500ml-20>
- <https://www.hannainstruments.co.uk/ph-10-01-buffer-solution.html>



- Note the ambient temperature at the time of calibration to input the standard pH value according to the temperature (indicated on the body of the standard bottle)

Use any modbus master tool to calibrate the sensor. Or use Daviteq's Modbus software, along with a configuration cable...

- How to use Modbus Configuration Tool (Click Here)

**Step 1:** Import the Template file into Modbus Configuration Tool

	Func	Reg	Num	Format	Prm Name	Setting Value	Read Value	CLEAR	Ex
1	<input checked="" type="checkbox"/> 3	9	2	float	pH/ORP value				
2	<input checked="" type="checkbox"/> 3	11	1	byte[]	err & sen_type				
3	<input checked="" type="checkbox"/> 3	12	2	float	Temp oC				
4	<input checked="" type="checkbox"/> 3	14	2	float	ADC value				
5	<input checked="" type="checkbox"/> 3	16	2	float	mV value				
6	<input checked="" type="checkbox"/> 3	18	2	float	PT100 value				
7	<input checked="" type="checkbox"/> 3	280	2	float	a1 ORP				
8	<input checked="" type="checkbox"/> 3	282	2	float	b1 ORP				
9	<input type="checkbox"/> 16	299	1	uint	pH calibEnb	1			
10	<input type="checkbox"/> 16	300	2	float	pH Feedback	7			
11	<input checked="" type="checkbox"/> 3	302	2	float	pH Factor				
12	<input checked="" type="checkbox"/> 3	304	2	float	pH 7 adc				
13	<input checked="" type="checkbox"/> 3	306	2	float	pH 7 mV				
14	<input checked="" type="checkbox"/> 3	308	2	float	PT100 wireRes				
15	<input checked="" type="checkbox"/> 3	310	2	float	tempManInput				
16	<input checked="" type="checkbox"/> 3	312	1	uint	tempManEnb				
* 17	<input type="checkbox"/>								

**Step 2:** Place pH sensor into a beaker containing pH=7.01 buffer but not calibrated yet

Daviteq Modbus Configuration Tool Version 1.5

FILE EDIT

Port: COM10 BaudRate: 9600 Parity: none

Disconnect

Status: connected tx rx

06.046.tx: 00 03 00 08 00 01 F4 19  
 06.123.rx: 00 03 02 00 11 45 88  
 06.138.tx: 00 03 00 0C 00 02 05 D9  
 06.202.rx: 00 03 04 41 D4 FC C7 BE 65  
 06.204.tx: 00 03 00 0E 00 02 A4 19

	Func	Reg	Num	Format	Prm Name	Setting Value	Read Value	CLEAR	Ex
1	<input checked="" type="checkbox"/> 3	9	2	float	pH/ORP value		7.111083984375		
2	<input checked="" type="checkbox"/> 3	11	1	byte[]	err & sen_type		0 - 17		
3	<input checked="" type="checkbox"/> 3	12	2	float	Temp oC		26.6234264373779		
4	<input checked="" type="checkbox"/> 3	14	2	float	ADC value		9877		
5	<input checked="" type="checkbox"/> 3	16	2	float	mV value		-6.9375		
6	<input checked="" type="checkbox"/> 3	18	2	float	PT100 value		110.348770141602		
7	<input checked="" type="checkbox"/> 3	280	2	float	a1 ORP		1		
8	<input checked="" type="checkbox"/> 3	282	2	float	b1 ORP		0		
9	<input type="checkbox"/> 16	299	1	uint	pH calibEnb	1			
10	<input type="checkbox"/> 16	300	2	float	pH Feedback	7			
11	<input checked="" type="checkbox"/> 3	302	2	float	pH Factor		0.300000011920929		
12	<input checked="" type="checkbox"/> 3	304	2	float	pH 7 adc		9988		
13	<input checked="" type="checkbox"/> 3	306	2	float	pH 7 mV		624.25		
14	<input checked="" type="checkbox"/> 3	308	2	float	PT100 wireRes		1.74000000953674		
15	<input checked="" type="checkbox"/> 3	310	2	float	tempManInput		0		
16	<input checked="" type="checkbox"/> 3	312	1	uint	tempManEnb		0		
* 17	<input type="checkbox"/>								

**Step 3:** Wait about **3 minutes** for the reading from the sensor to stabilize, write **7** down into pHFeedback **Register 300** and value=1 for phcalibEnb **Reg 299** by using Func 16

Daviteq Modbus Configuration Tool Version 1.5

FILE EDIT

Port: COM10 BaudRate: 9600 Parity: none

Disconnect

Status: connected tx rx

46.848.tx: 00 03 00 0C 00 02 05 D9  
 46.909.rx: 00 03 04 41 D4 C0 59 2E CD  
 46.915.tx: 00 03 00 0E 00 02 A4 19  
 46.970.rx: 00 03 04 46 1A 5C 00 E7 7C  
 46.973.tx: 00 03 00 10 00 02 C4 1F  
 47.047.rx: 00 03 04 00 00 00 00 EA F3

	Func	Reg	Num	Format	Prm Name	Setting Value	Read Value	CLEAR	Ex
1	<input checked="" type="checkbox"/> 3	9	2	float	pH/ORP value		7		
2	<input checked="" type="checkbox"/> 3	11	1	byte[]	err & sen_type		0 - 17		
3	<input checked="" type="checkbox"/> 3	12	2	float	Temp oC		26.5939197540283		
4	<input checked="" type="checkbox"/> 3	14	2	float	ADC value		9879		
5	<input checked="" type="checkbox"/> 3	16	2	float	mV value		0		
6	<input checked="" type="checkbox"/> 3	18	2	float	PT100 value		110.337333679199		
7	<input checked="" type="checkbox"/> 3	280	2	float	a1 ORP		1		
8	<input checked="" type="checkbox"/> 3	282	2	float	b1 ORP		0		
9	<input type="checkbox"/> 16	299	1	uint	pH calibEnb	1	OK		
10	<input type="checkbox"/> 16	300	2	float	pH Feedback	7	OK		
11	<input checked="" type="checkbox"/> 3	302	2	float	pH Factor		0.300000011920929		
12	<input checked="" type="checkbox"/> 3	304	2	float	pH 7 adc		9879		
13	<input checked="" type="checkbox"/> 3	306	2	float	pH 7 mV		617.4375		
14	<input checked="" type="checkbox"/> 3	308	2	float	PT100 wireRes		1.74000000953674		
15	<input checked="" type="checkbox"/> 3	310	2	float	tempManInput		0		
16	<input checked="" type="checkbox"/> 3	312	1	uint	tempManEnb		0		
* 17	<input type="checkbox"/>								

**Step 4:** Remove the electrode from the buffer. Rinse with distilled water and blot with a lab wipe then put it to **pH=10.01** standard

Daviteq Modbus Configuration Tool Version 1.5

FILE EDIT

Port: COM10 BaudRate: 9600 Parity: none

Disconnect

Status: connected tx rx

52.873.tx: 00 03 01 32 00 02 65 E9  
 52.946.rx: 00 03 04 44 1A 5C 00 E6 C4  
 52.949.tx: 00 03 01 34 00 02 85 E8  
 53.024.rx: 00 03 04 3F DE B8 52 75 20  
 53.044.tx: 00 03 01 36 00 02 24 28

tx	2296	09/07_14:34
rx	2296	Run Program
ok	2296	09/07_14:35
crc	0	connected
tmo	0	

	Func	Reg	Num	Format	Prm Name	Setting Value	Read Value	CLEAR	Ex
1	<input checked="" type="checkbox"/>	3	9	2	float	pH/ORP value	9.76125621795654		
2	<input checked="" type="checkbox"/>	3	11	1	byte[]	err & sen_type	0 - 17		
3	<input checked="" type="checkbox"/>	3	12	2	float	Temp oC	26.3875827789307		
4	<input checked="" type="checkbox"/>	3	14	2	float	ADC value	7122		
5	<input checked="" type="checkbox"/>	3	16	2	float	mV value	-172.3125		
6	<input checked="" type="checkbox"/>	3	18	2	float	PT100 value	110.257278442383		
7	<input checked="" type="checkbox"/>	3	280	2	float	a1 ORP	1		
8	<input checked="" type="checkbox"/>	3	282	2	float	b1 ORP	0		
9	<input type="checkbox"/>	16	299	1	uint	pH calibEnb	1		
10	<input type="checkbox"/>	16	300	2	float	pH Feedback	7		
11	<input checked="" type="checkbox"/>	3	302	2	float	pH Factor	0.300000011920929		
12	<input checked="" type="checkbox"/>	3	304	2	float	pH 7 adc	9879		
13	<input checked="" type="checkbox"/>	3	306	2	float	pH 7 mV	617.4375		
14	<input checked="" type="checkbox"/>	3	308	2	float	PT100 wireRes	1.74000000953674		
15	<input checked="" type="checkbox"/>	3	310	2	float	tempManInput	0		
16	<input checked="" type="checkbox"/>	3	312	1	uint	tempManEnb	0		
* 17	<input type="checkbox"/>								

**Step 5:** Wait about **3 minutes** for the reading to stabilize, write down the pHFeedback with **10** into **Reg 300**

Daviteq Modbus Configuration Tool Version 1.5

FILE EDIT

Port: COM10 BaudRate: 9600 Parity: none

Disconnect

Status: connected tx rx

14.362.tx: 00 03 00 09 00 02 15 D8  
 14.440.rx: 00 03 04 41 20 28 F6 61 43  
 14.456.tx: 00 03 00 08 00 01 F4 19  
 14.520.rx: 00 03 02 00 11 45 88  
 14.523.tx: 00 03 00 0C 00 02 05 D9

tx	2576	09/07_14:34
rx	2576	Run Program
ok	2576	09/07_14:35
crc	0	connected
tmo	0	

	Func	Reg	Num	Format	Prm Name	Setting Value	Read Value	CLEAR	Ex
1	<input checked="" type="checkbox"/>	3	9	2	float	pH/ORP value	10.0100002288818		
2	<input checked="" type="checkbox"/>	3	11	1	byte[]	err & sen_type	0 - 17		
3	<input checked="" type="checkbox"/>	3	12	2	float	Temp oC	26.3581085205078		
4	<input checked="" type="checkbox"/>	3	14	2	float	ADC value	7120		
5	<input checked="" type="checkbox"/>	3	16	2	float	mV value	-172.4375		
6	<input checked="" type="checkbox"/>	3	18	2	float	PT100 value	110.24584197998		
7	<input checked="" type="checkbox"/>	3	280	2	float	a1 ORP	1		
8	<input checked="" type="checkbox"/>	3	282	2	float	b1 ORP	0		
9	<input type="checkbox"/>	16	299	1	uint	pH calibEnb	1		
10	<input type="checkbox"/>	16	300	2	float	pH Feedback	10.01		
11	<input checked="" type="checkbox"/>	3	302	2	float	pH Factor	0.326755911111832		
12	<input checked="" type="checkbox"/>	3	304	2	float	pH 7 adc	9879		
13	<input checked="" type="checkbox"/>	3	306	2	float	pH 7 mV	617.4375		
14	<input checked="" type="checkbox"/>	3	308	2	float	PT100 wireRes	1.74000000953674		
15	<input checked="" type="checkbox"/>	3	310	2	float	tempManInput	0		
16	<input checked="" type="checkbox"/>	3	312	1	uint	tempManEnb	0		
* 17	<input type="checkbox"/>								

**Step 6:** Write down the pHcalibEnb with **0** into **Reg 299** to stop the calibration. Then rinse the electrode with distilled water and wipe carefully with a clean lab wipe.

# 10. Reading a Sample with the Electrode

1. Rinse the electrode with distilled water and blot with a lab wipe. Place the electrode in a beaker containing the sample and a stir bar. The sample should be at the same temperature as the buffers used to standardize the electrode. Stir as before. Record the pH when the reading is stable.
2. Remove the electrode from the sample, rinse the electrode with distilled water over the "waste" beaker. Blot the electrode dry with a lab wipe. The electrode is now ready to read the pH of other samples.

# 11. Storing the Electrode

## 1. Sort Term

Between measurements, store the pH electrode in a beaker containing pH**4.01** buffer.

## 2. Long Term

When storing for longer periods, store the pH electrode in the storage bottle or the protective boot which came with the electrode. Ensure that the foam in the storage bottle or the cotton ball in the protective boot is totally wetted with pH storage solution to keep a wet environment around the pH bulb and junction. Maintain the wet environment in the storage bottle or in the protective boot during storage.

If the pH electrode is equipped with a fill hole cover, slip the cover over the fill hole.

# 12. Electrode Cleaning

Do not use strong solvents (e.g. acetone, carbon tetrachloride, etc.) to clean the pH electrode. Be sure to recalibrate the electrode after cleaning.

1. If the electrode has become coated with oil or grease, carefully wash the electrode under warm tap water using dish-washing detergent. Rinse thoroughly with fresh tap water followed by a rinse with distilled water. Soak the electrode in pH electrode storage solution for 30 minutes after this cleaning procedure. Recalibrate the electrode before use.
2. If the electrode has been exposed to protein or similar materials, soak in acidic pepsin for 5 minutes. Rinse thoroughly with distilled water. Soak in storage solution for 30 minutes prior to recalibration.
3. If the previous cleaning procedures fail to restore response, soak the electrode in 0.1 N HCl for 30 minutes. Rinse thoroughly with distilled water. Recalibrate before use.
4. If electrode response is not restored still, replace the electrode.

# 13. Contact



No.11 Street 2G, Nam Hung Vuong Res., An Lac Ward, Binh Tan Dist., Ho Chi Minh City, Vietnam.  
Tel: +84-28-6268.2523/4 (ext.122)  
Email: [info@daviteq.com](mailto:info@daviteq.com) | [www.daviteq.com](http://www.daviteq.com)